

May 31, 2023

To All Bidders:

Subject: Bid No. 8022-W3, Temporary Chiller Installation – WPD HQ / DPF

**ADDENDUM NO. 1** 

To Whom It May Concern:

With reference to our bid request relative to the above subject, please refer to the changes/modifications/clarifications to the original proposal request.

## • PLEASE FIND BELOW/ATTACHED GENERAL BID CLARIFICATIONS INCLUDING UPDATED DRAWING A2.01

Changes to project manual:

Section 05 12 00 - Structural Steel

Item 001 At page 5, add the following Article to Part 3 – Execution:


3.2 Hoisting Steel

A. All hoisting and rigging of structural steel members required for this project shall be provided, furnished and installed in safe conditions. All crane work must include an approved lift plan. Coordinate all crane activity and scheduled with the Owner.

Bidders are requested to acknowledge and/or include this addendum with submission. All other terms, conditions and specifications remain unchanged.


Very truly yours,


Christopher J. Gagliastro Purchasing Director

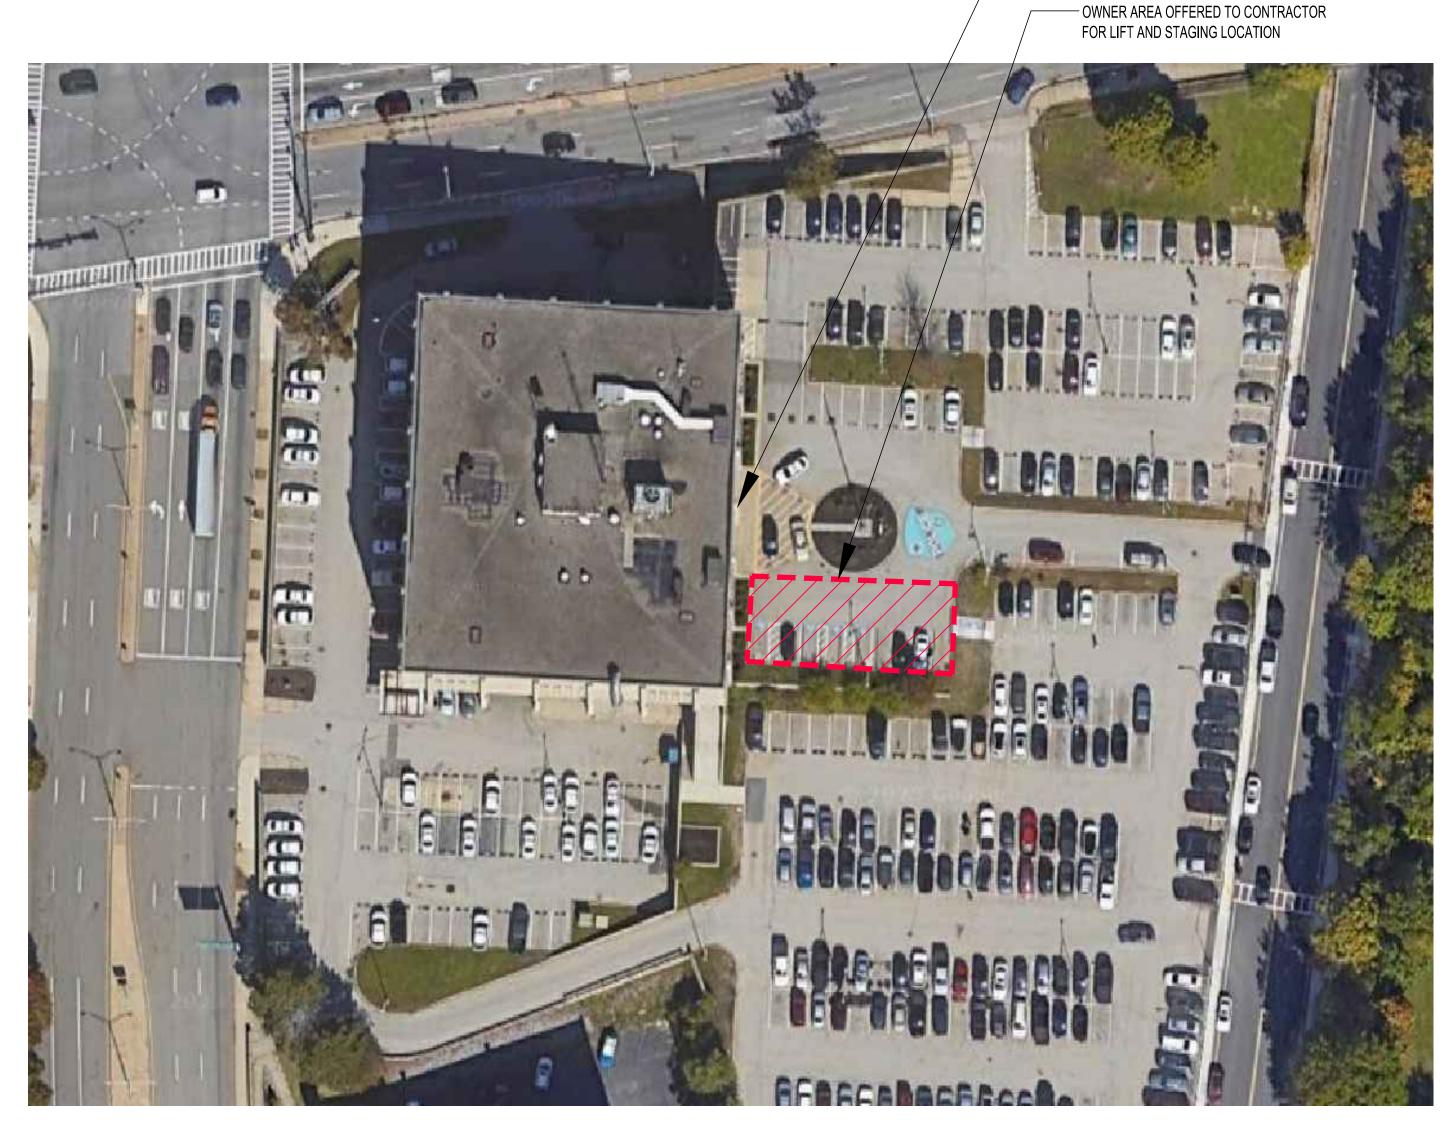

- MAIN BUILDING ENTRANCE



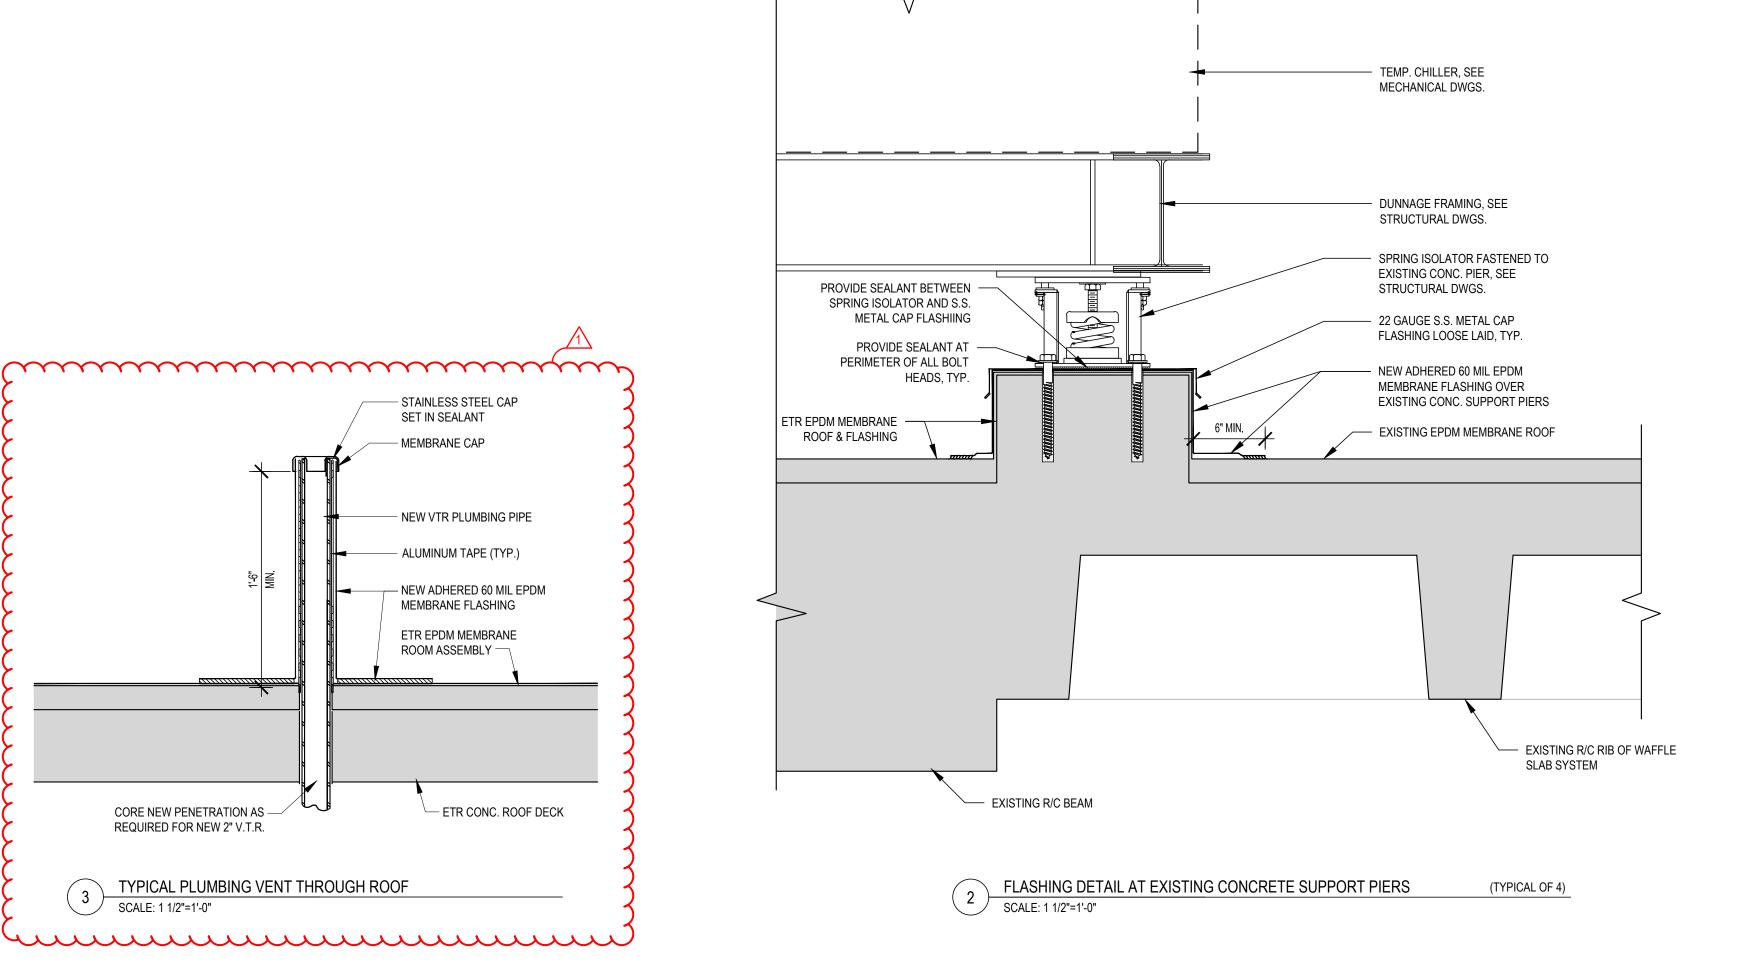

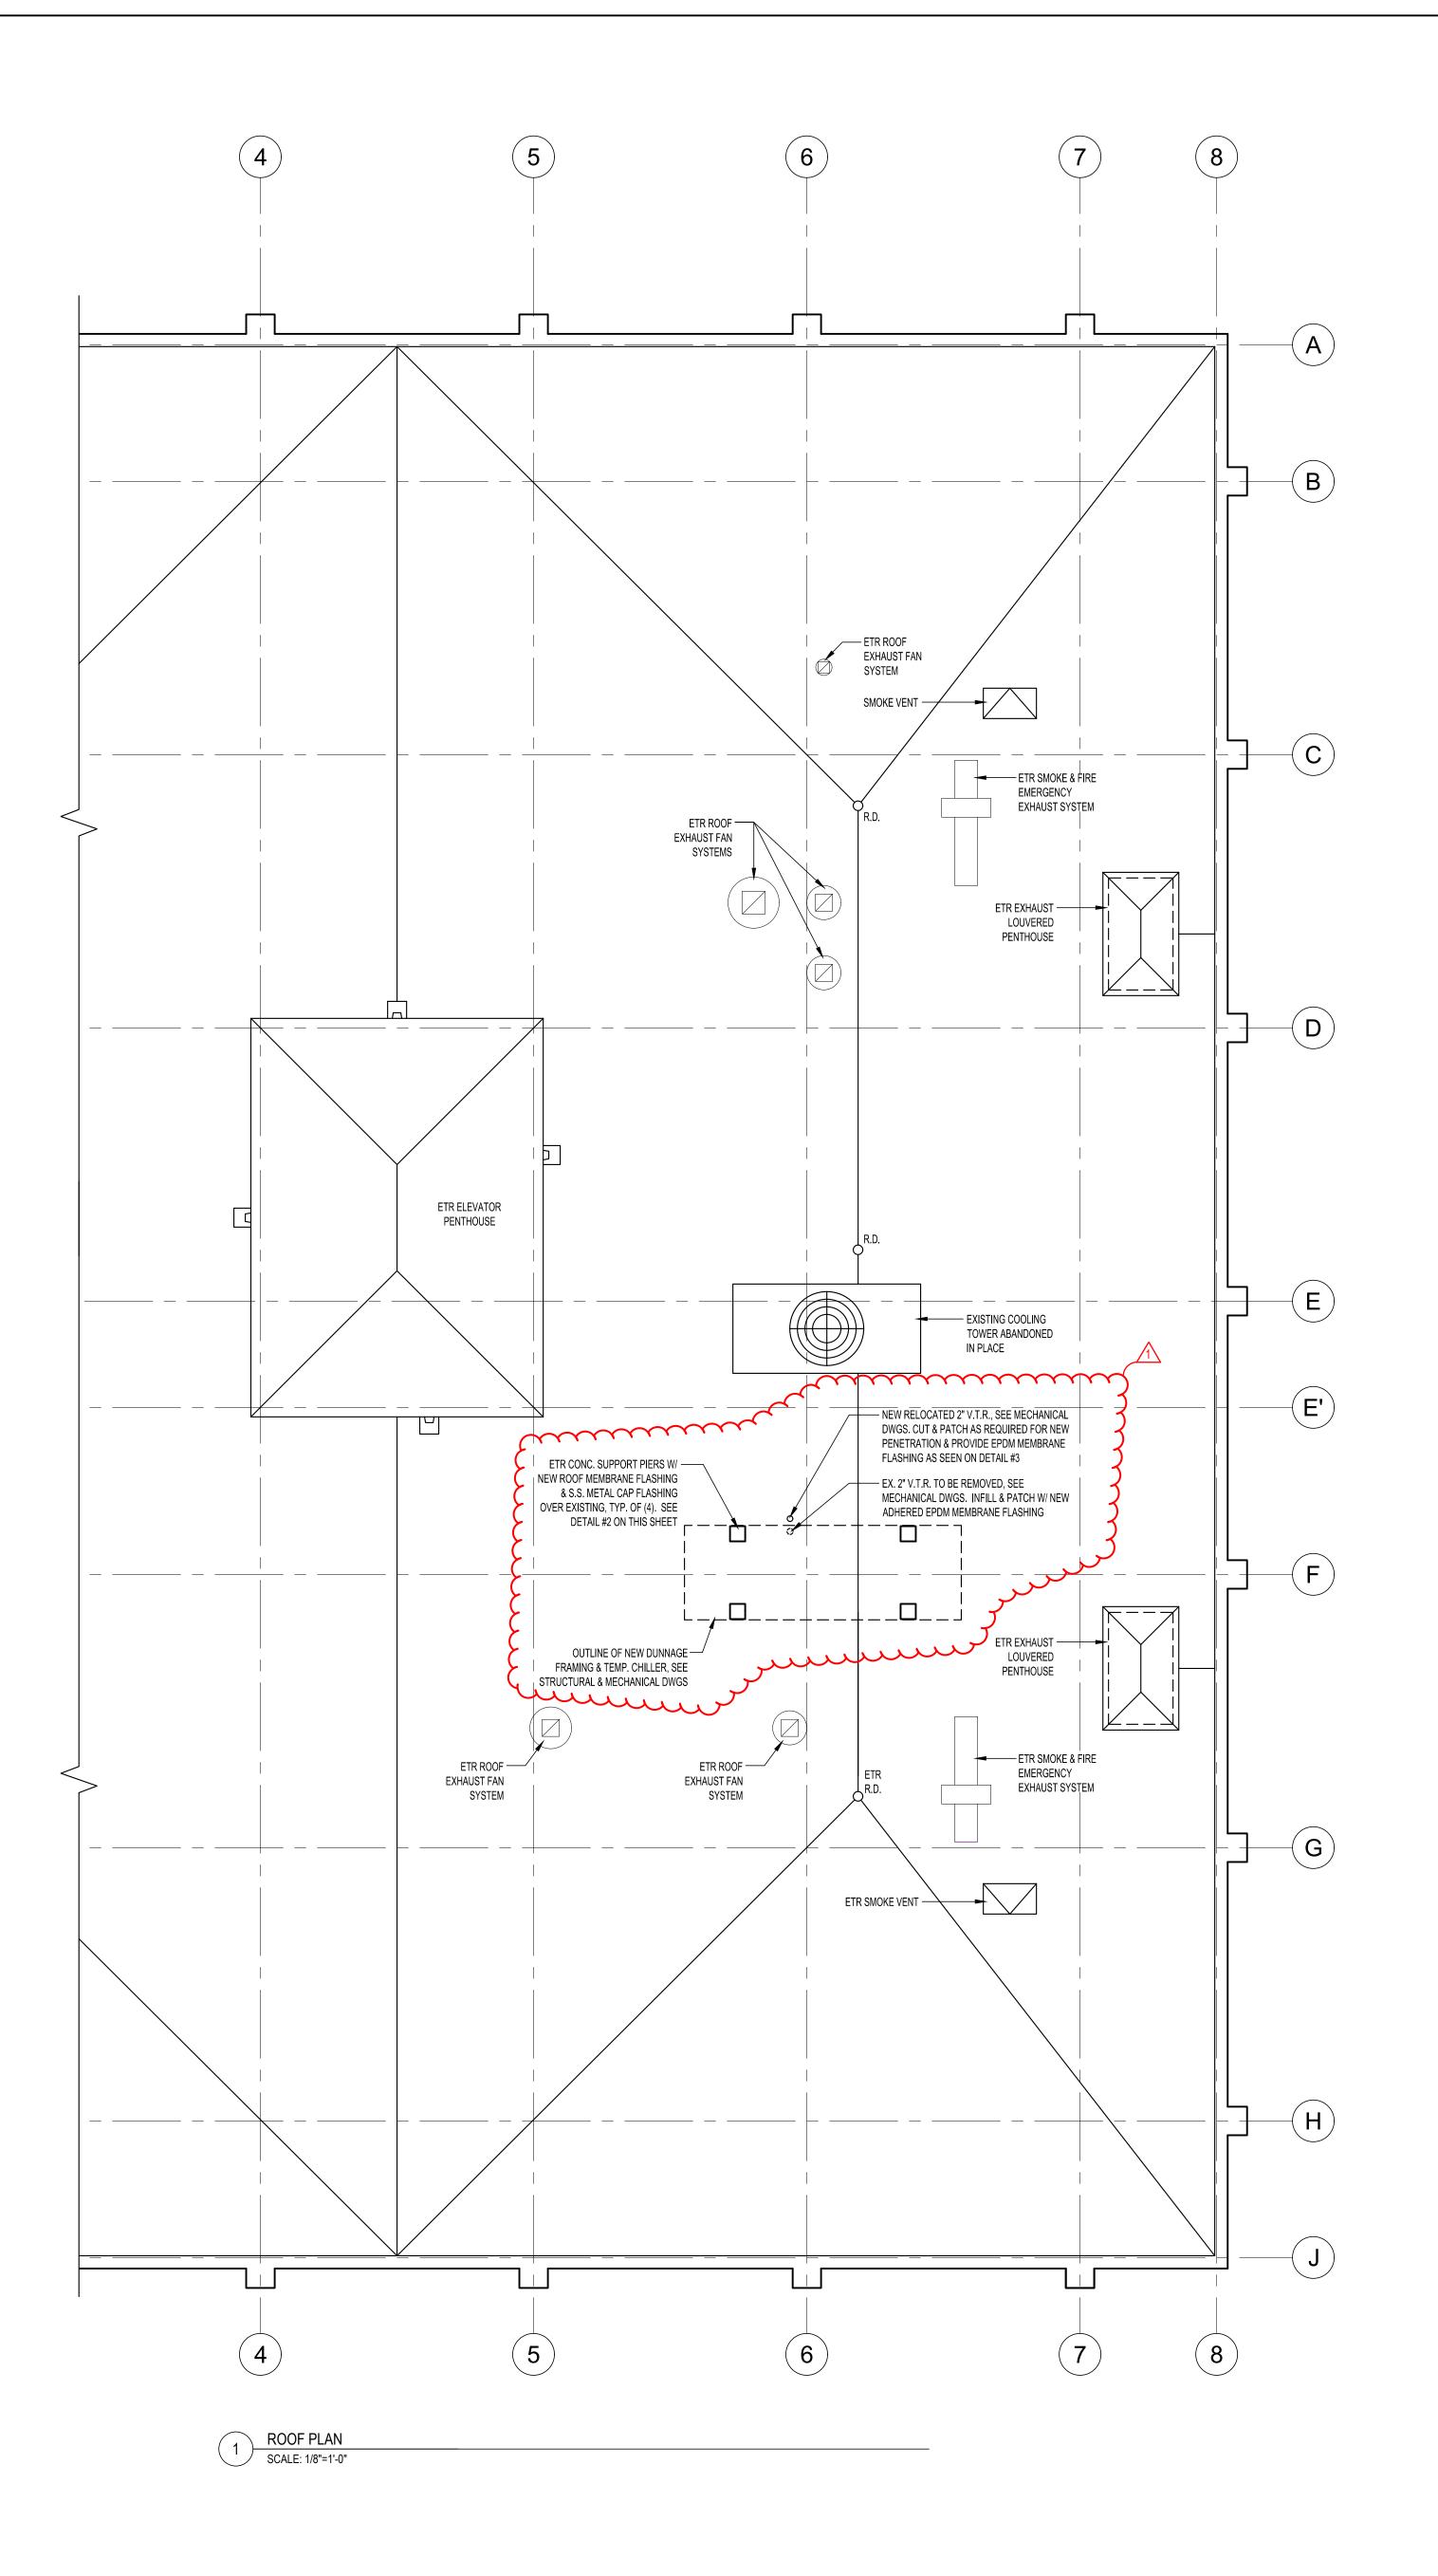

NORTH ARROW

CONSULTANTS

CVISIONS

ADDENDUM #1 May 31, 2023

PROJECT PHASE

PROJECT NUMBER

**BID SET** 

PROJECT NAME/LOCATION

WORCESTER

POLICE

HEADQUARTERS

TEMP. CHILLER

02023.03

9-11 LINCOLN SQUARE WORCESTER, MA 01608

REPLACEMENT

DRAWING TITLE

ROOF PLAN, ROOF DETAIL & CONTRACTOR STAGING/ LIFT AREA PARAMETERS



178 Albion Street Suite 240 Wakefield, Massachusetts 01880

781 213 5030 T 781 213 5040 F info@mvgarchitects.com E

STAMP

DRAWING INFORMATION

SCALE AS INDICATED

DRAWN BY H.C.

CHECKED F.T.

DATE MAY 24, 2023

DRAWING NUMBER

A2.01