



The City of
WORCESTER

Administration & Finance – Purchasing Division
Christopher J. Gagliastro, MCPPO – Purchasing Director
455 Main Street, Room 201, Worcester, MA 01608
P | 508-799-1220
purchasing@worcesterma.gov

October 20, 2026

To All Bidders:

Subject: **Bid No. CR-8785-J7 – Traffic Signal Maintenance, Repair & Improvements / DTM**

ADDENDUM NO. 2

To Whom It May Concern:

With reference to our bid request relative to the above subject, please refer to the changes/modifications/clarifications to the original proposal request.

Questions Received by this Office and Answers from the City:



1. Q: Can you please provide the Specifications for the foundation types for items 610.8 & 815.008?

- A: Please see the attached.

Bidders are requested to acknowledge and/or include this addendum with submission. All other terms, conditions and specifications remain unchanged.

Very truly yours,

Jerry Kucera
Buyer

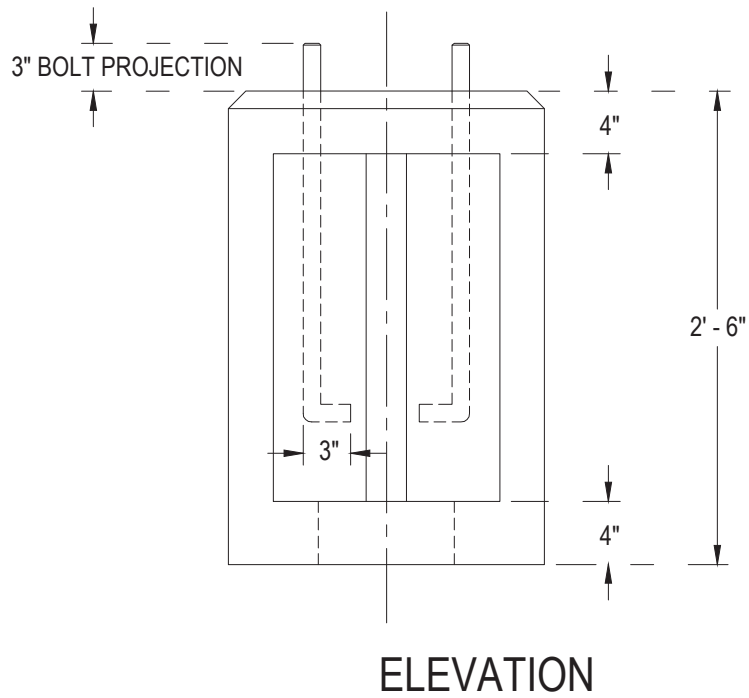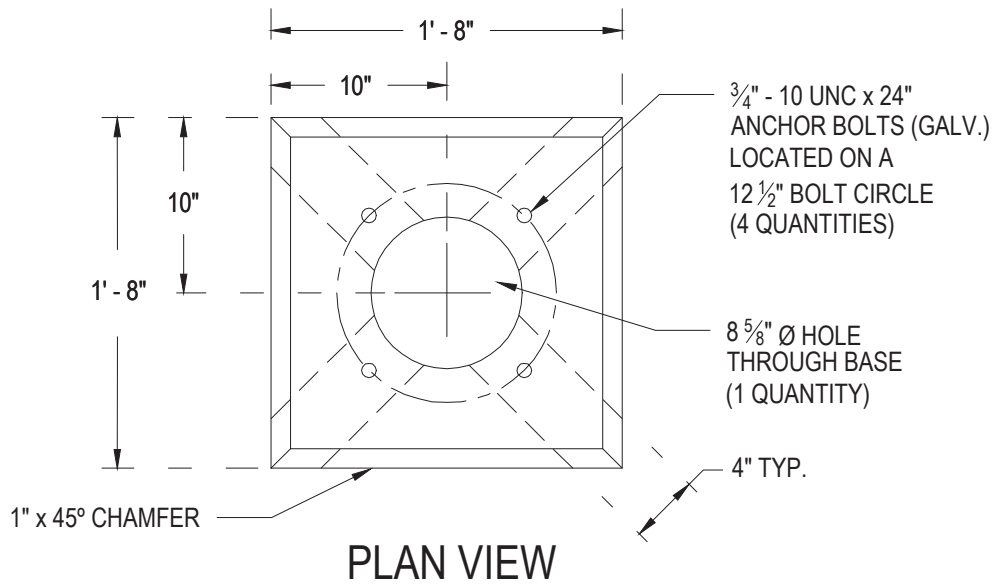

NOTES:

1. CONCRETE: 28 DAY COMPRESSIVE STRENGTH F' E = 5,000 PSI TYPE III.
2. REBAR: GRADE 60 PER ASTM A615 (EPOXY).



**RECTANGULAR RAPID FLASHING BEACON (RRFB)
SIGNAL POST FOUNDATION 520 Lbs. MHD**


CITY OF WORCESTER STANDARD DETAILS

SCALE:
N.T.S.

DATE OF ISSUE:
-

SPEC. SECTION REF#:
-

DRAWING NUMBER
-

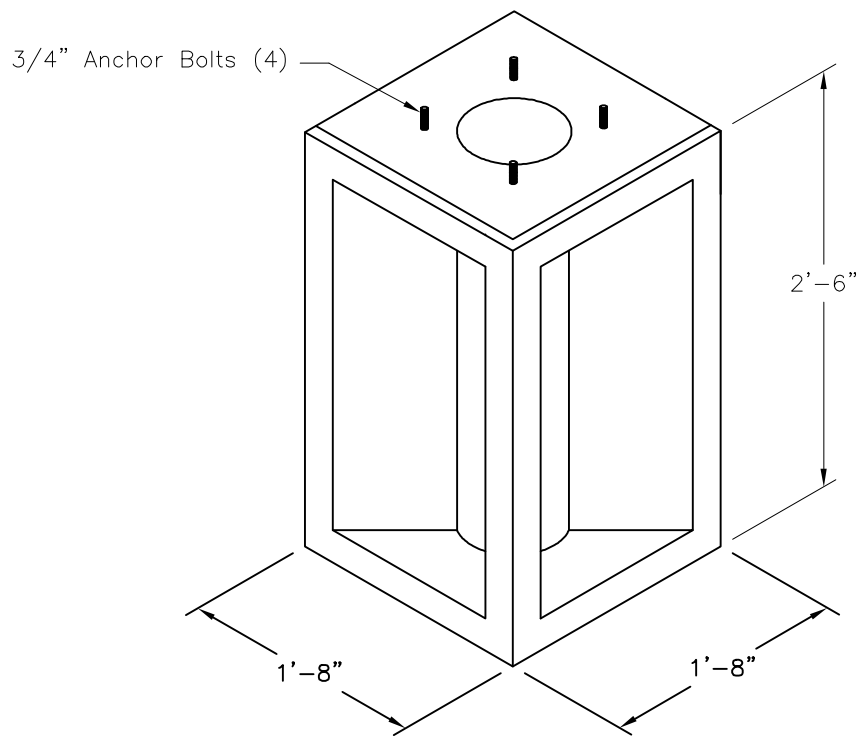

Oldcastle Precast®

SPF2020

FILE NAME: 325MAM20X20_ISO.DWG

ISSUE DATE: January, 2008

www.oldcastleprecast.com

1'-8" x 1'-8" x 2'-6"
Signal Post Foundation
MHD
520 Lbs.


Copyright © 2008 **Oldcastle Precast®**

GENERAL NOTES:

1. Concrete: 28 Day Compressive Strength $f'_c = 5,000$ psi Type III.
2. Rebar: Grade 60 Per ASTM A615 (Epoxy).

DATA CHART

LTR	QTY	Description
(A)	4	$\frac{3}{4}$ "-10 UNC x 24" Anchor Bolt (Galv.)
(B)	1	$8\frac{5}{8}$ " ϕ Hole (Thru)

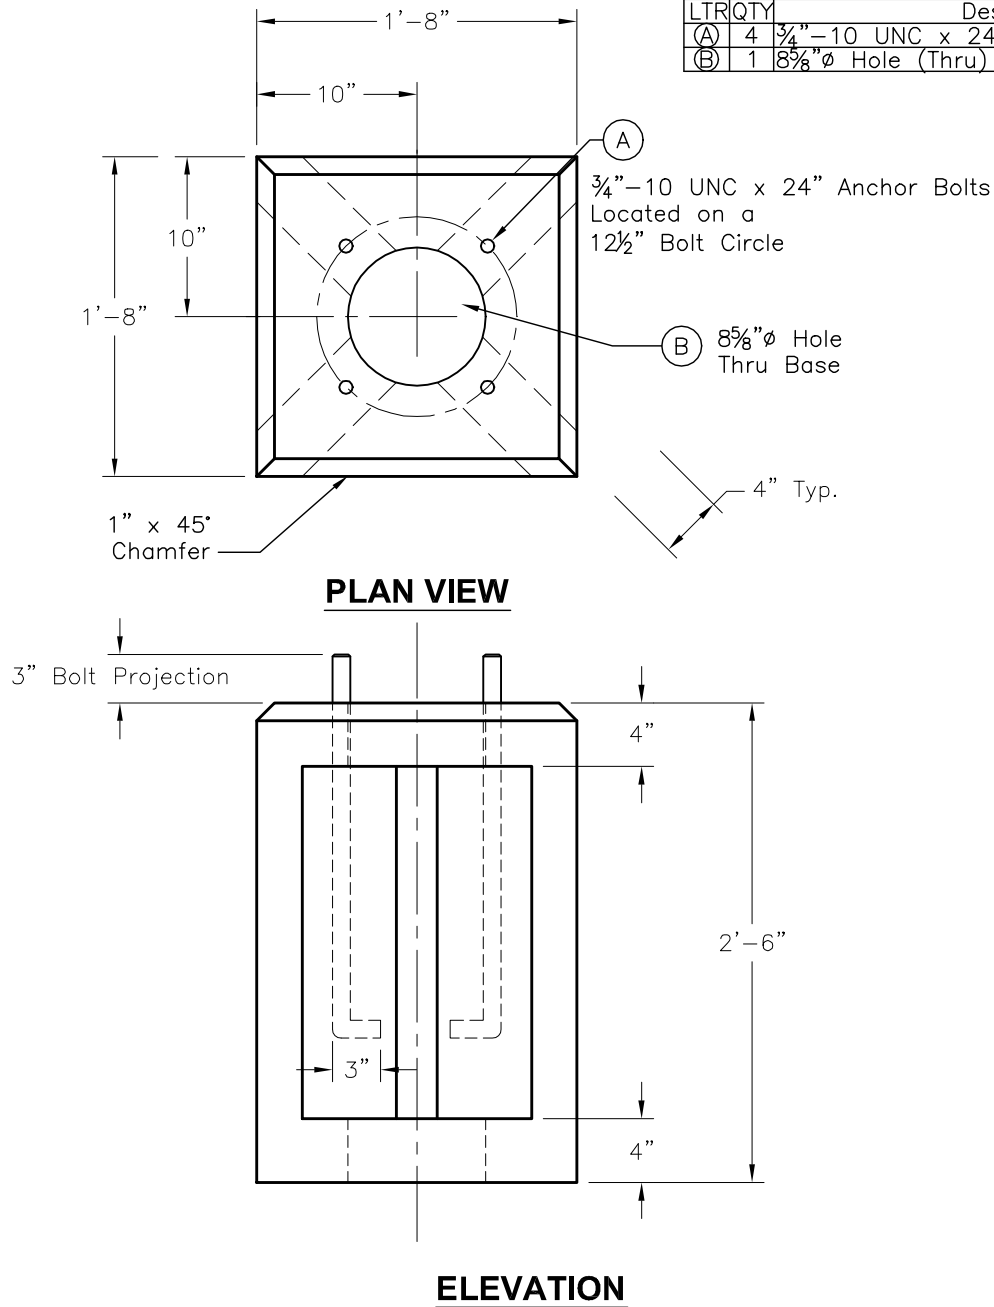

SPF2020

FILE NAME: 325MAM20X20_DET.DWG

ISSUE DATE: January, 2008

www.oldcastleprecast.com

1'-8" x 1'-8" x 2'-6"
Signal Post Foundation
520 Lbs.
MHD

Copyright © 2008 **Oldcastle Precast**